


ENGINEERING STANDARD

OAK RIDGE TENNESSEE

NUMBER	ES-5.12-4
DATE	8-3-84
REVISED	
PAGE	1 of 1

FIRE DAMPER - FIRE PARTITION - DUCT MOUNTED

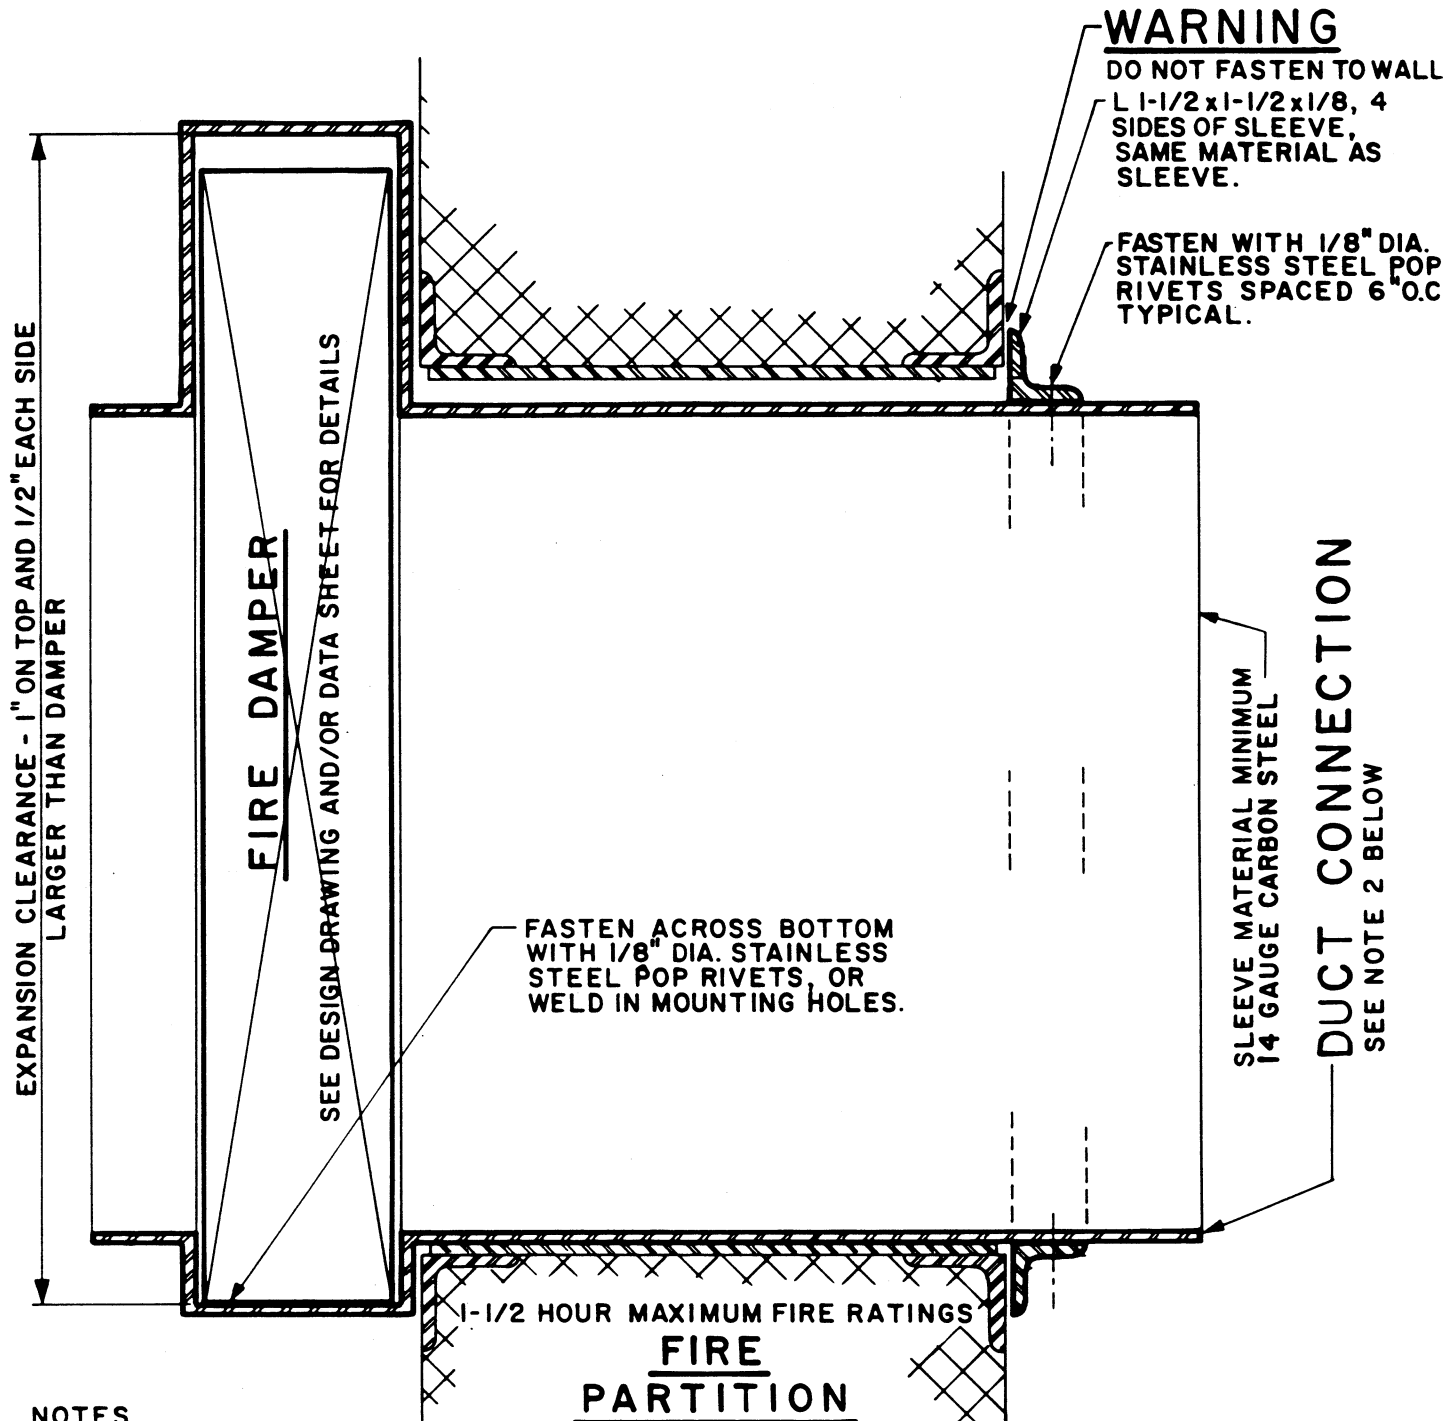

NOTES

1. ALL FIRE DAMPER INSTALLATIONS SHALL BE INSPECTED AND APPROVED BY FIRE DEPARTMENT DAMPER, OPERATION AND INSTALLATION SHALL BE IN ACCORDANCE WITH NFPA STANDARD 90A.
2. DUCT CONNECTION AT EACH END OF SLEEVE SHALL BE DONE IN ACCORDANCE WITH DESIGN DRAWINGS AND DUCTWORK SPECIFICATIONS.
3. ACCESS DOOR SHALL BE LOCATED AS NEAR AS POSSIBLE TO FUSE, LATCH AND LINKAGE. DOOR SHALL BE A MINIMUM 16 x 24 DUAL METAL WALL WITH 1" INSULATION BY VENTFABRICS, INC., OR DURO-DYNE CORP.

APPROVED BY

W. E. L. Lattin

NUMBER

ES-5.12-4